


NOTE:
 POLE SHALL BE HARD WIRED USING
 (2) NO. 10 COND. A 15 AMP CIRCUIT
 BREAKER SHALL BE INSTALLED FOR
 THE ENTIRE RRFB PED CROSSING.



DEPARTMENT OF PUBLIC WORKS

STANDARD DETAIL

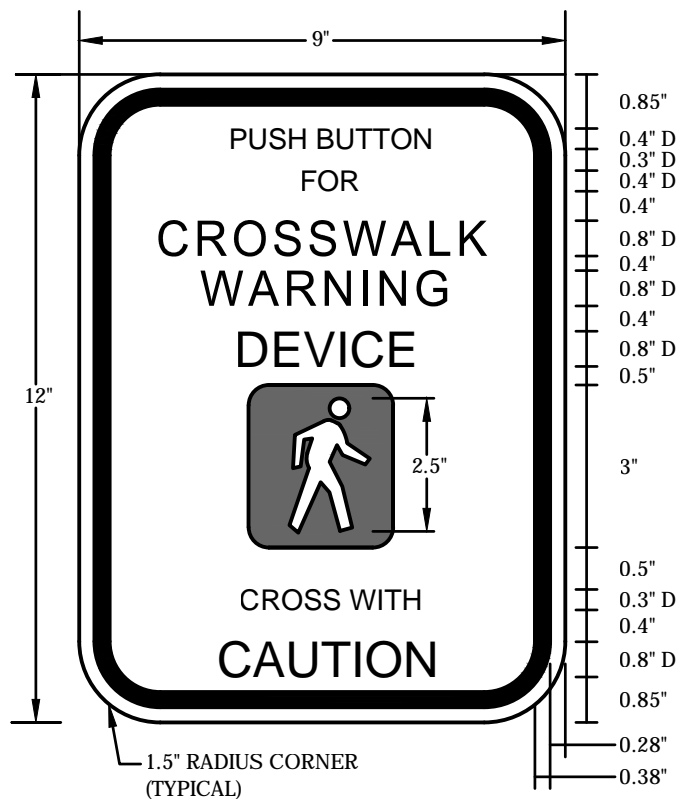

DATE: 6/13/19

DRAWN BY: LJPC

SHEET: 1 OF 1

PROWAG AND
 DOWNTOWN PROJECTS

PEDESTRIAN PUSH
 BUTTON SIGN